



No. ARTICLE	PART NUMBER	DESCRIPTION	QTY
1	121967	DISCONNECTOR SBE 52KV 3150A	3
2	34397T	FLAT-END SHAFT-Ø36x460	4
3	16669C	SLEEVE	8
4	103913	CRANK HANDLE ARM	2
5	103896	LINKAGE CRANK HANDLE	2
6	103859	TUBE	2
7	117960	MANUAL OPERATING MECHANISM T70	3

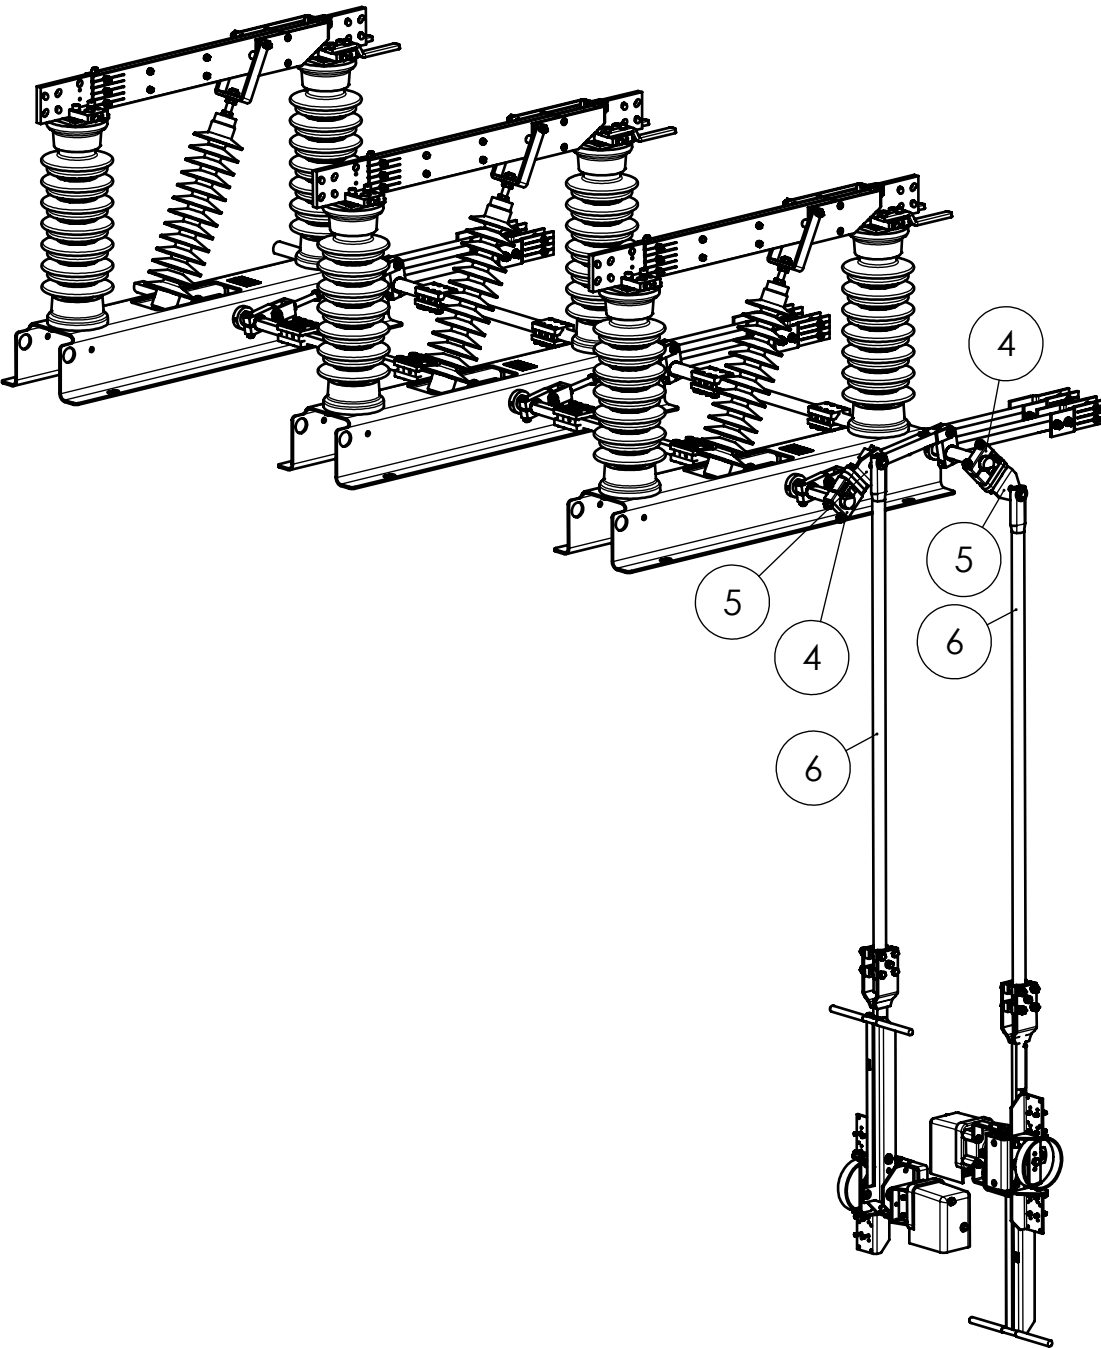

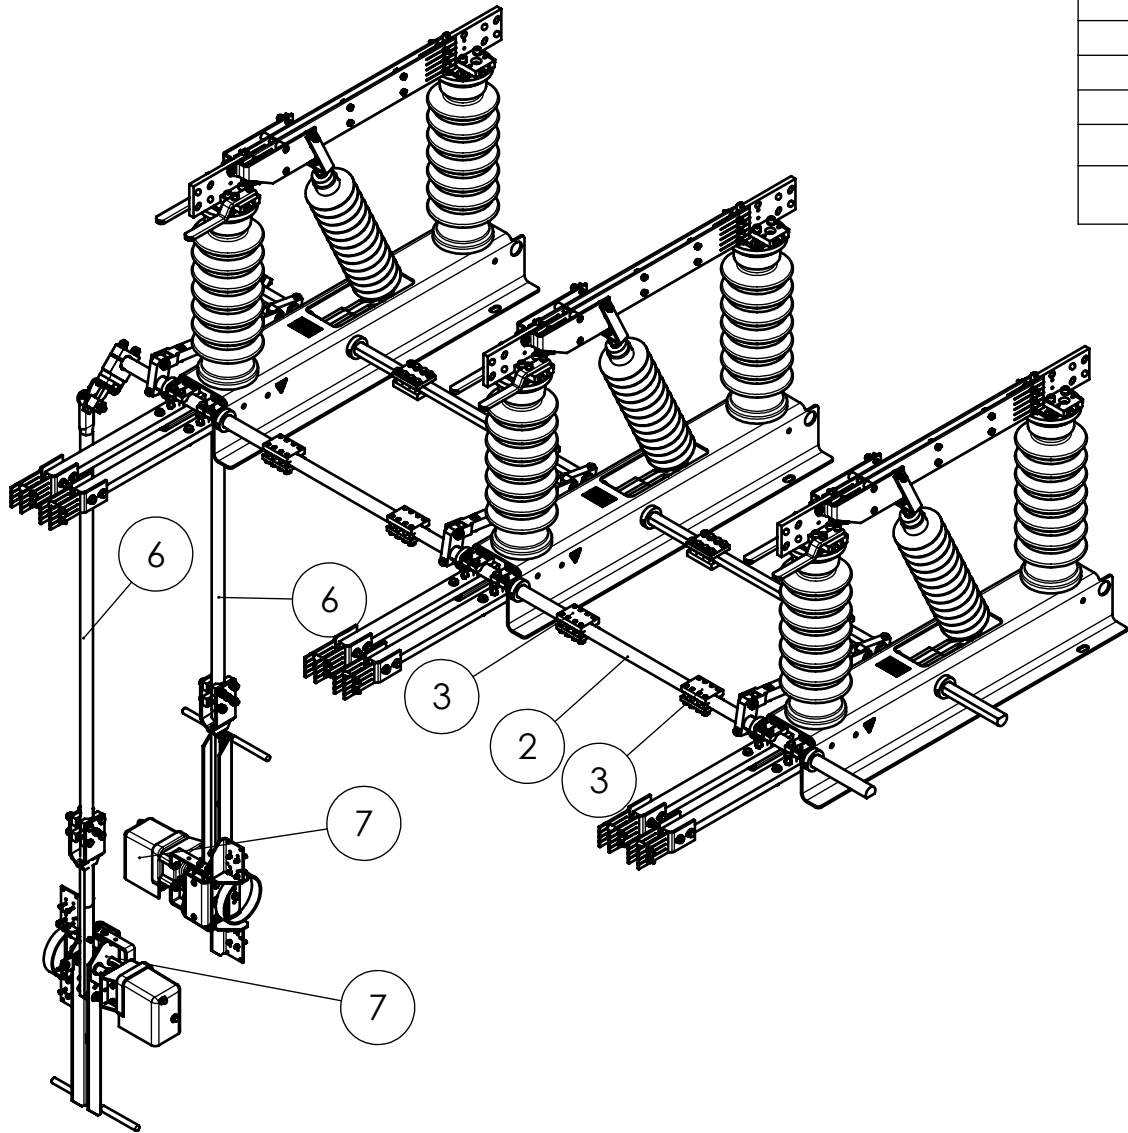

LES SUPPORTS ET CALAGES HORS NOMENCLATURE NE SONT PAS DE FOURNITURE SDCEM.
FRAMES AND BRACKETS WHICH ARE NOT IN THE SCHEDULE ARE NOT SUPPLIED BY SDCEM.



L'INSTALLATEUR DOIT S'ASSURER QUE LES DISTANCES ENTRE L'OPERATEUR ET LES PARTIES SOUS TENSION SOIENT CONFORMES AUX DIRECTIVES EN VIGUEUR ET PREVOIR LA PROTECTION APPROPRIEE.
THE CONTRACTOR MUST CHECK THAT THE DISTANCE BETWEEN THE OPERATOR AND LIVES PARTS ARE COMPLYING WITH THE LOCAL RULES AND INSTALL APROPRIATE SAFETY GUARD.

FOR THE EQUIPMENT WHICH IS NOT SHOWN ON THE DRAWING, THE CONTARCTOR MUST CHECK THE CLEARANCES BETWEEN LIVES PARTS AND EARTH, AND BETWEEN PHASES.
POUR L'EQUIPEMENT NON REPRESENTE SUR LE PLAN, L'INSTALLATEUR DOIT VERIFIER LES DISTANCES ENTRE LES PARTIES SOUS TENSION ET LA MASSE, ET ENTRE LES PHASES.

TOLERANCE DIMENSIONNELLE NON SPECIFIEE = ±10%
DIMENSIONAL TOLERANCE UNSPECIFIED = ±10%

Libellés / Titles :			SBE 52Kv 3150A 1 EARTHING SWITCH MANUAL OPERATING MECHANISM T70						
Statut /Status:				ERECTION DRAWING				SEULS LES DOCUMENTS REMIS EN CONFIRMATION DE COMMANDE NOUS ENGAGENT POUR EXECUTION CONFORME ONLY DOCUMENTS SUBMITTED AS ORDER MAY BE CONSIDERED AS BINDING FOR MANUFACTURING PURPOSE	
				REVISION	DATE	MODIFICATION	DESSINE / BY	VERIFIE / CHECKED	APPROUVE / APPROVED
A3				00	24/05/2018	CREATION	SFE	SB	SFE
Ech. / Scale: 1:20		PAGE / SHEET 2/2		CE DOCUMENT, PROPRIETE DE SDCEM NE PEUT ETRE NI COMMUNIQUE NI UTILISE SANS SON AUTORISATION THIS DRAWING IS THE SOLE PROPERTY OF SDCEM ANY REPRODUCTION OR USE IS PROHIBITED WITHOUT WRITTEN PERMISSION			N° D0022757		

No. ARTICLE	PART NUMBER	DESCRIPTION	QTY
1	13079	DISCONNECTOR SBE 52kV 2000A	3
2	34397T	FLAT-END SHAFT-Ø36x460	6
3	16669C	SLEEVE ACCESSOIRES	12
4	103913	CRANK HANDLE ARM	3
5	103896	LINKAGE CRANK HANDLE	3
6	103859	TUBE	3
7	117960	MANUAL OPERATING MECHANISM T70	3

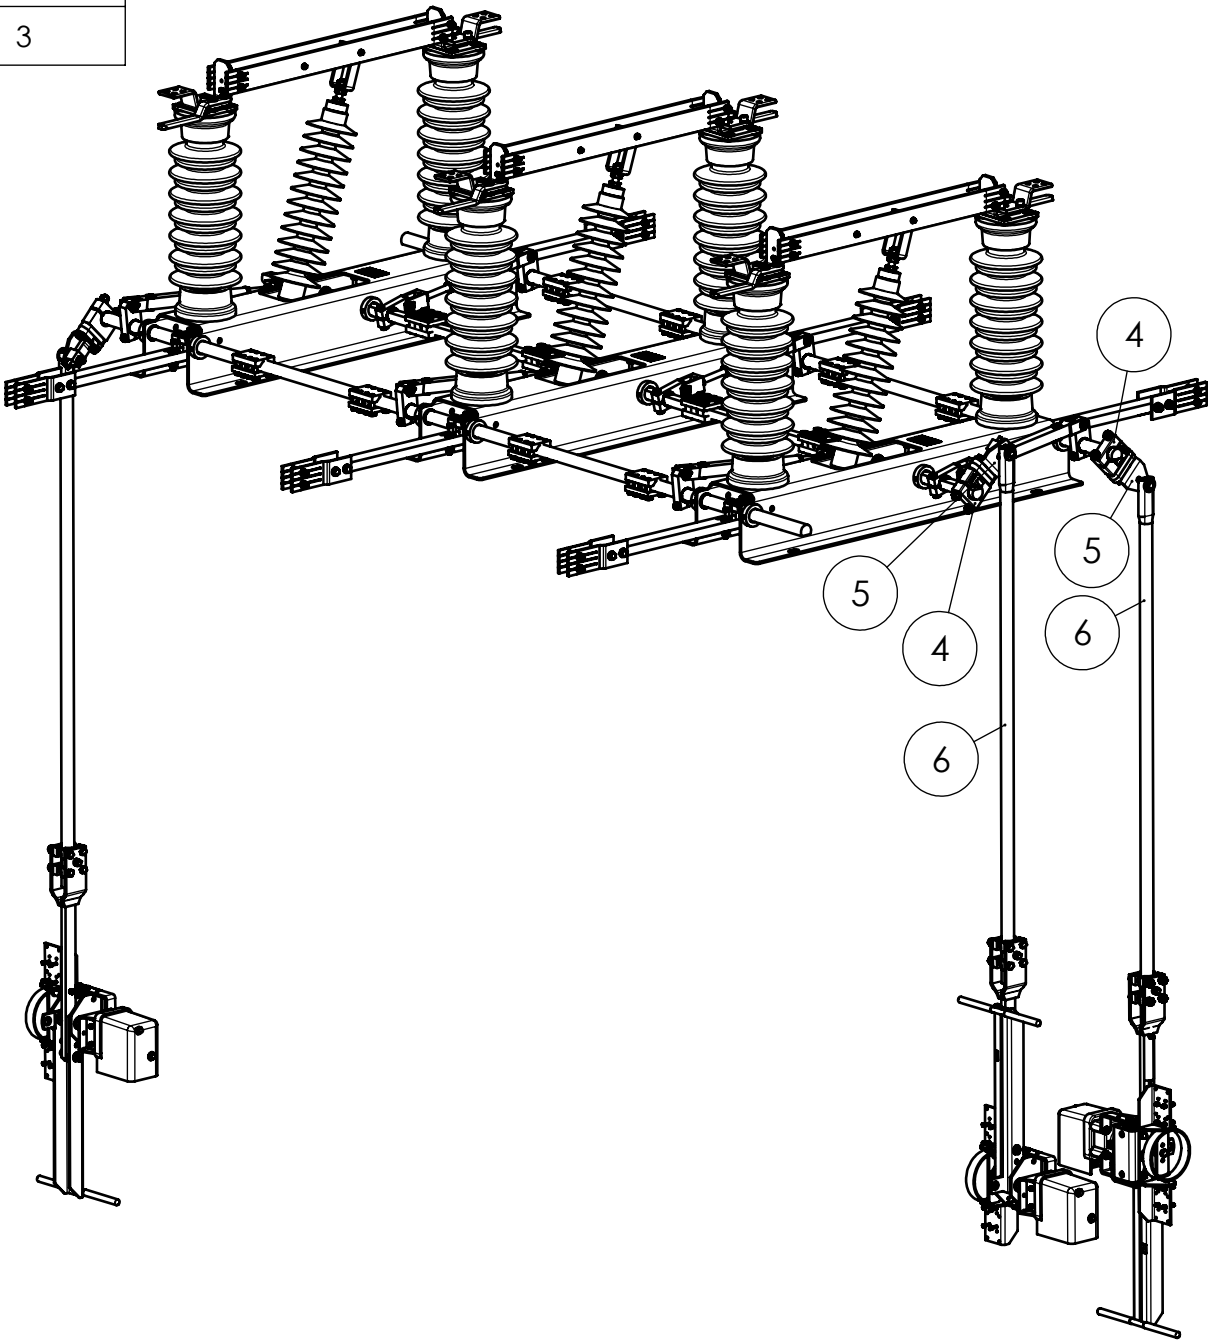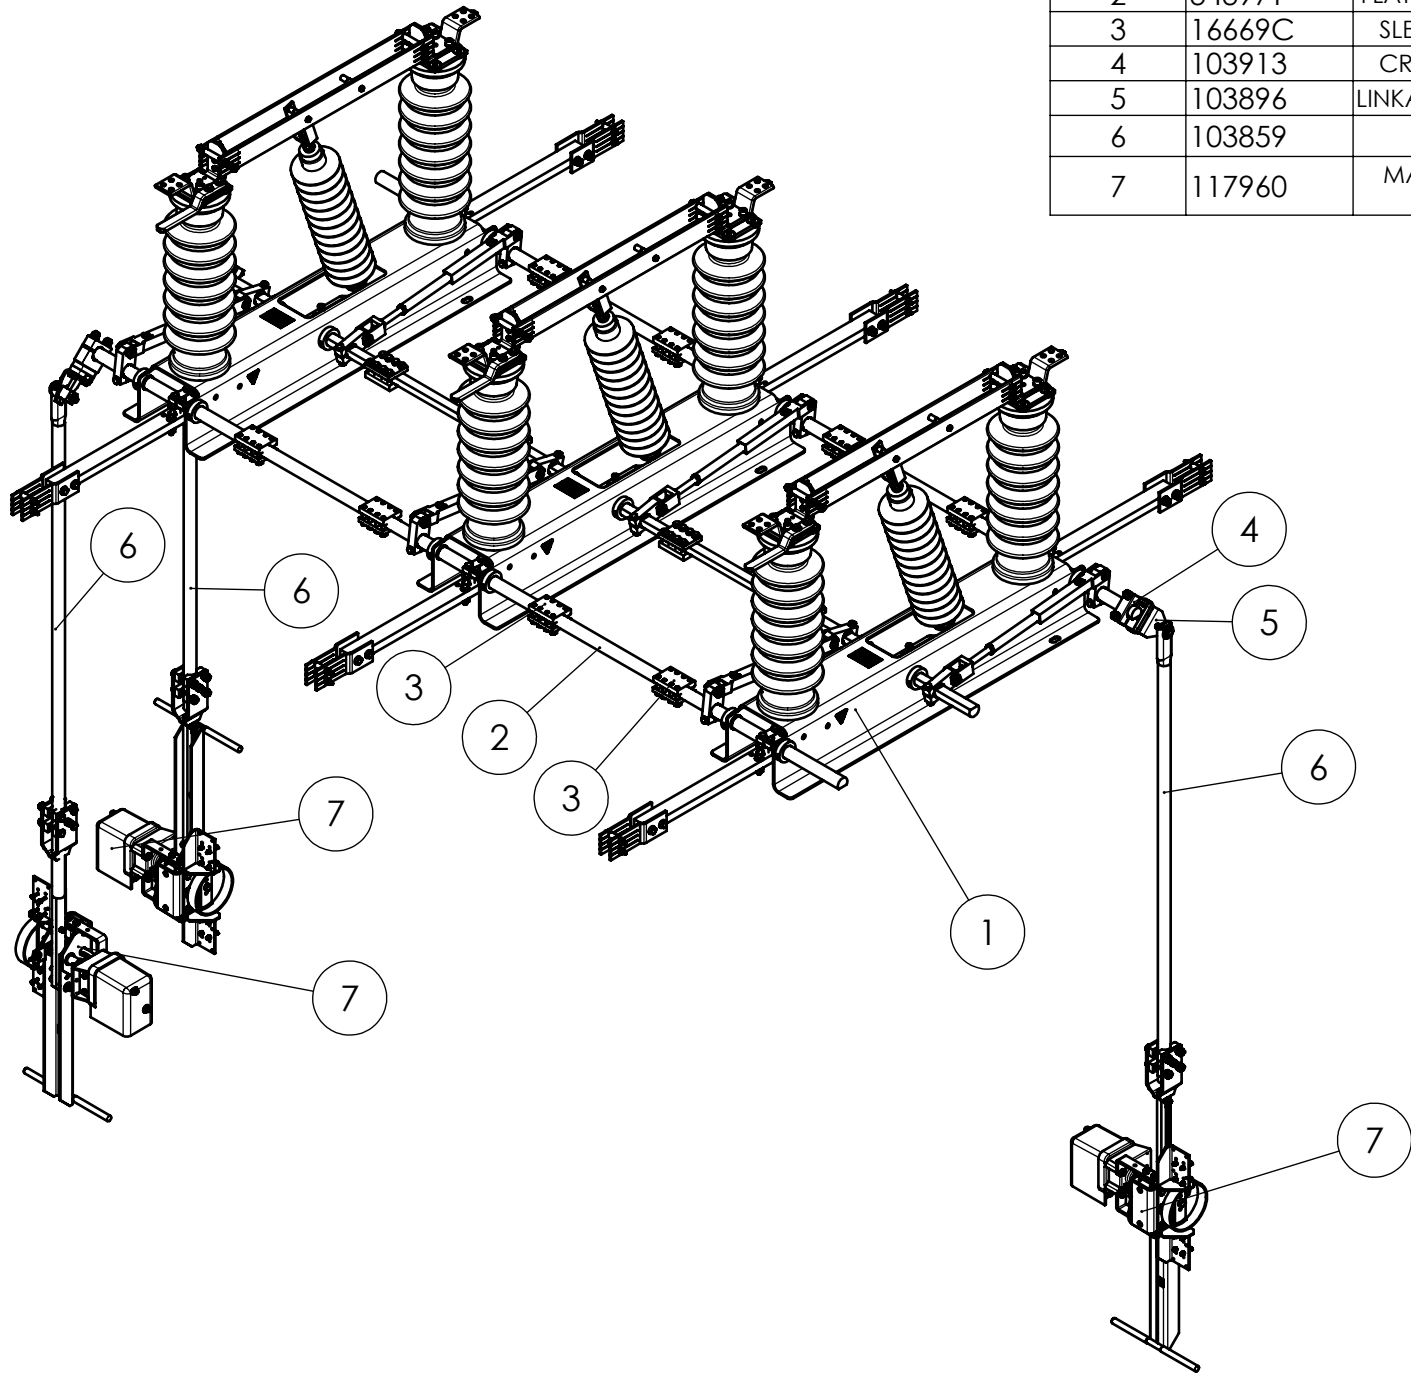




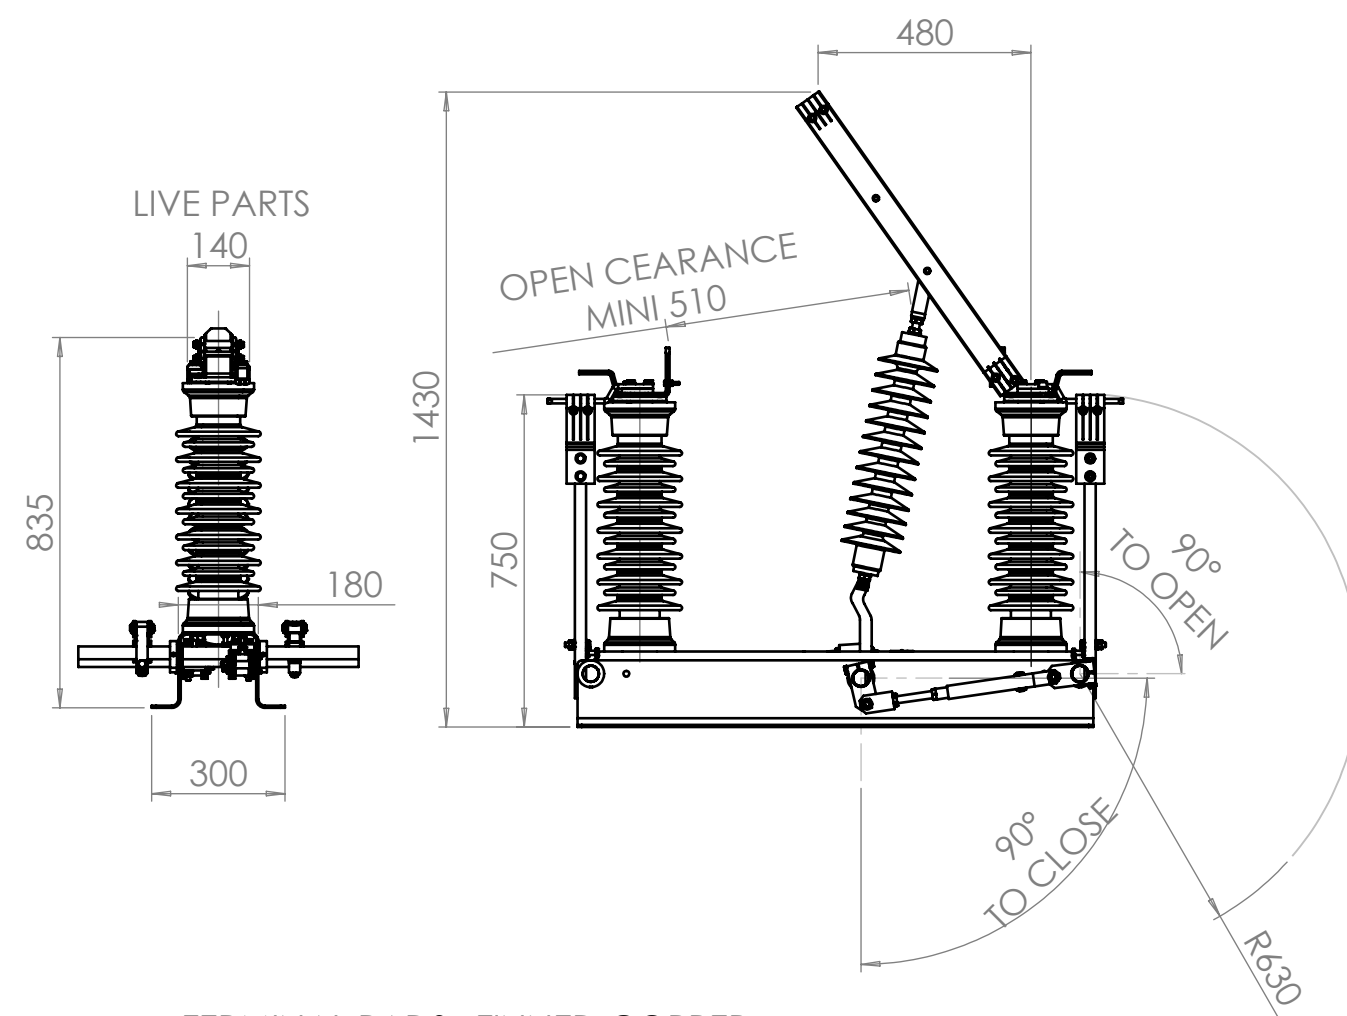
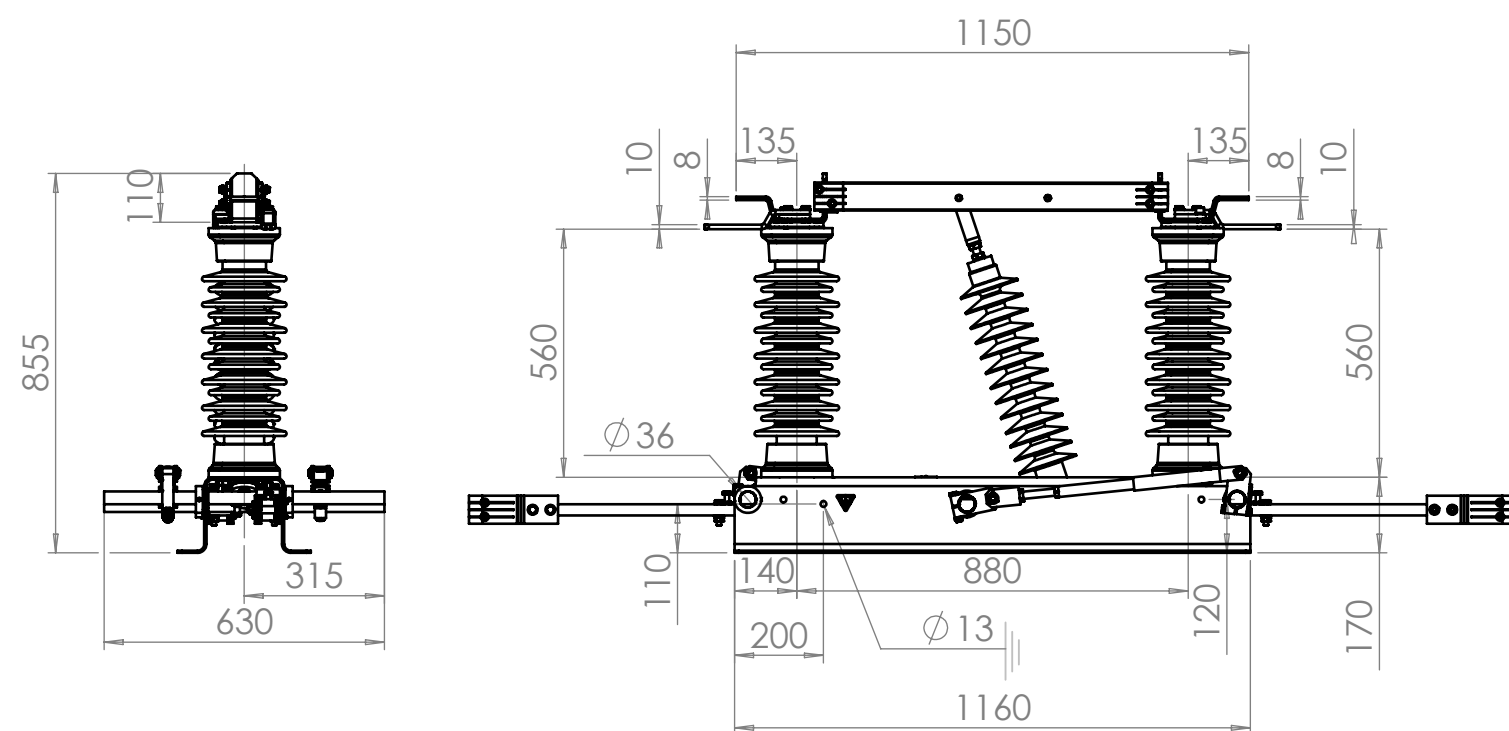
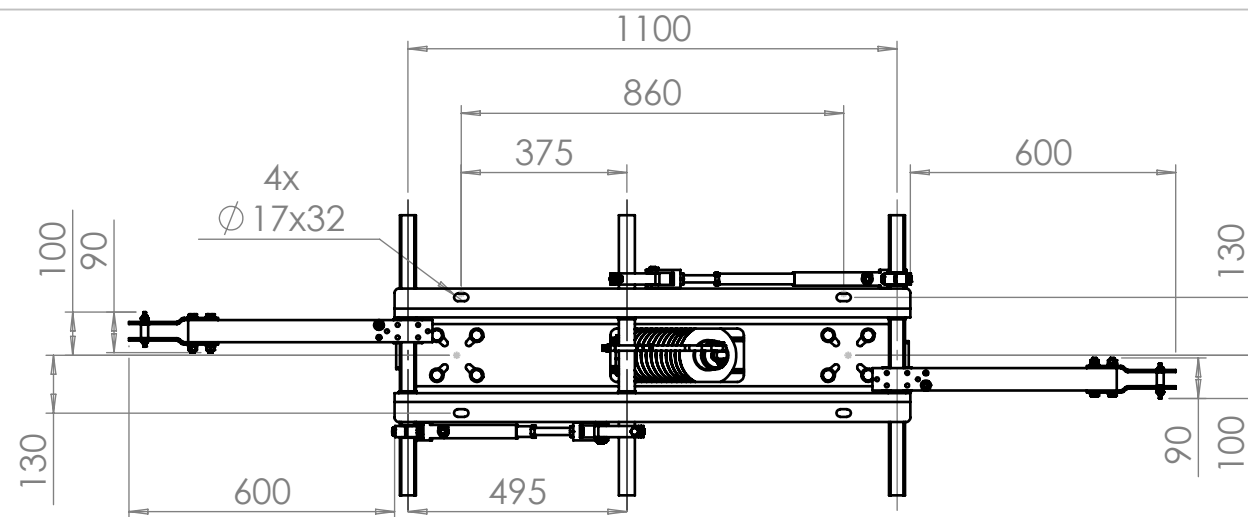
LES SUPPORTS ET CALAGES HORS NOMENCLATURE NE SONT PAS DE FOURNITURE SDCEM.
FRAMES AND BRACKETS WHICH ARE NOT IN THE SCHEDULE ARE NOT SUPPLIED BY SDCEM.

L'INSTALLATEUR DOIT S'ASSURER QUE LES DISTANCES ENTRE L'OPERATEUR ET LES PARTIES SOUS TENSION
SOIENT CONFORMES AUX DIRECTIVES EN VIGUEUR ET PREVOIR LA PROTECTION APPROPRIEE.
THE CONTRACTOR MUST CHECK THAT THE DISTANCE BETWEEN THE OPERATOR AND LIVES PARTS
ARE COMPLYING WITH THE LOCAL RULES AND INSTALL APROPRIATE SAFETY GUARD.



FOR THE EQUIPMENT WHICH IS NOT SHOWN ON THE DRAWING, THE CONTARCTOR MUST CHECK THE CLEARANCES
BETWEEN LIVES PARTS AND EARTH, AND BETWEEN PHASES.
POUR L'EQUIPEMENT NON REPRESENTE SUR LE PLAN, L'INSTALLATEUR DOIT VERIFIER LES DISTANCES
ENTRE LES PARTIES SOUS TENSION ET LA MASSE, ET ENTRE LES PHASES.

TOLERANCE DIMENSIONNELLE NON SPECIFIEE = ±10%
DIMENSIONAL TOLERANCE UNSPECIFIED = ±10%

Libellés / Titles :			SBE 52kV 2000A 2 EARTHING SWITCH MANUAL OPERATING MECHANISM T70							
Statut /Status:				ERECTION DRAWING				SEULS LES DOCUMENTS REMIS EN CONFIRMATION DE COMMANDE NOUS ENGAGENT POUR EXECUTION CONFORME ONLY DOCUMENTS SUBMITTED AS ORDER MAY BE CONSIDERED AS BINDING FOR MANUFACTURING PURPOSE		
		REVISION		DATE	MODIFICATION	DESSINE / BY	VERIFIE / CHECKED			APPROUVE / APPROVED
A3		Ech. / Scale: 1:20		PAGE / SHEET 2/2	00	24/05/2018	CREATION			SFE
					CE DOCUMENT, PROPRIETE DE SDCEM NE PEUT ETRE NI COMMUNIQUE NI UTILISE SANS SON AUTORISATION THIS DRAWING IS THE SOLE PROPERTY OF SDCEM ANY REPRODUCTION OR USE IS PROHIBITED WITHOUT WRITTEN PERMISSION					
			N° D0022984							



TERMINAL PADS : TINNED COPPER

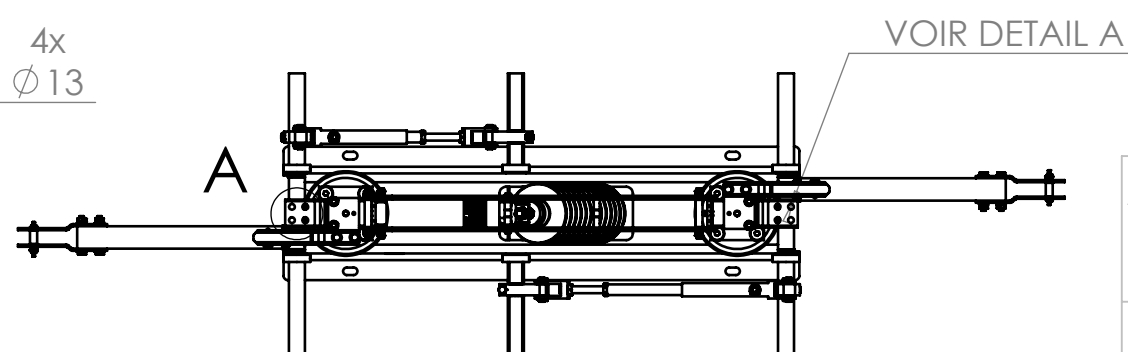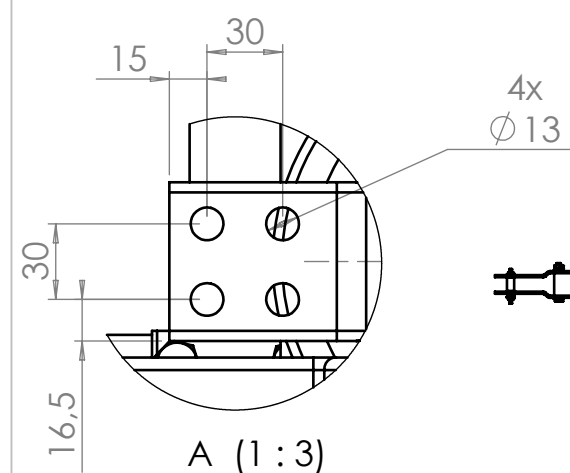

Libellés /
Titles :


SECTIONNEUR SBE 52kV-2000A DOUBLE MALT DISCONNAECTOR SBE 52kV-2000A WITH DOUBLE EARTHING-SWITCH

DIMENSION DRAWING						<small>SEULS LES DOCUMENTS REMIS EN CONFIRMATION DE COMMANDE NOUS ENGAGENT POUR EXECUTION CONFORME ONLY DOCUMENTS SUBMITTED AS ORDER MAY BE CONSIDERED AS BINDING FOR MANUFACTURING PURPOSE</small>
REVISION	DATE	MODIFICATION	DESSINE / BY	VERIFIE / CHECKED	APPROUVE / APPROVED	
00	23/05/2018	NEW	SFE	SB	SFE	

A3





Ech. / Scale:
1:17

PAGE /
SHEET
1/1




CE DOCUMENT, PROPRIETE DE SDCEM
NE PEUT ETRE NI COMMUNIQUE
NI UTILISE SANS SON AUTORISATION
THIS DRAWING IS THE SOLE PROPERTY
OF SDCEM ANY REPRODUCTION OR
USE IS PROHIBITED WITHOUT WRITTEN
PERMISSION


N° 130792-FR-EN

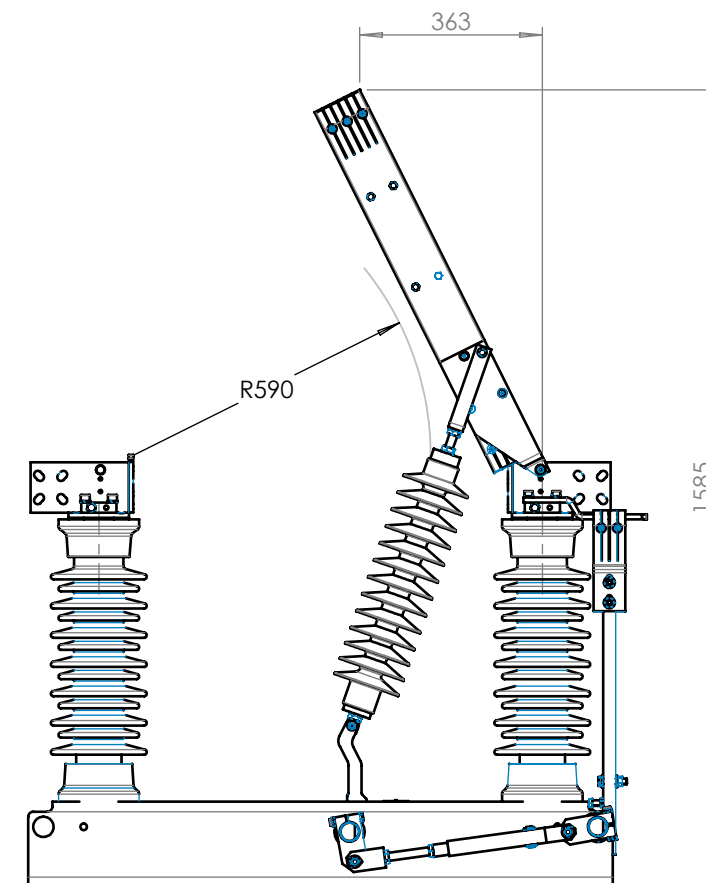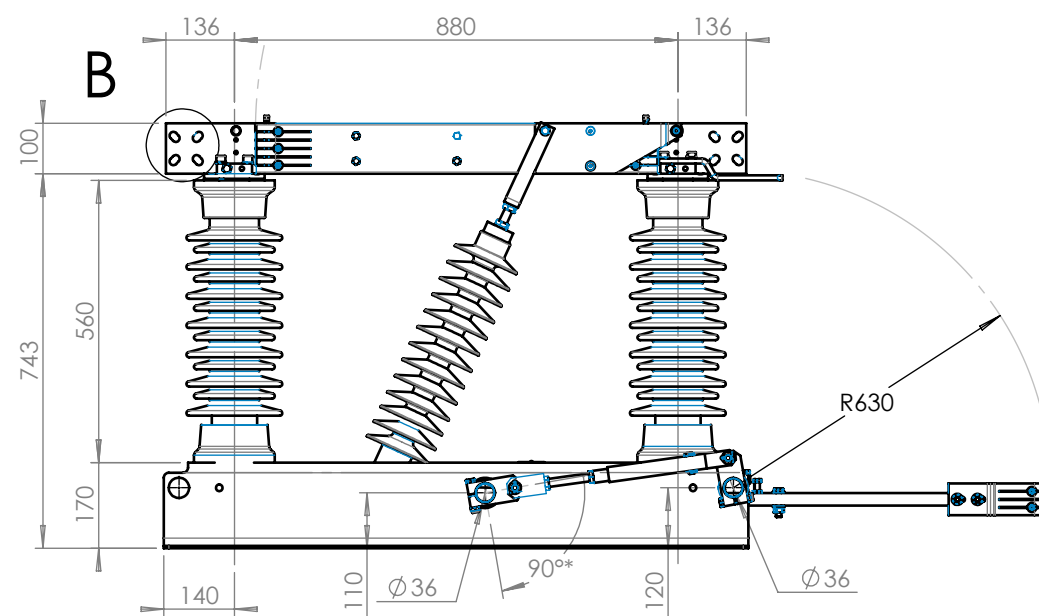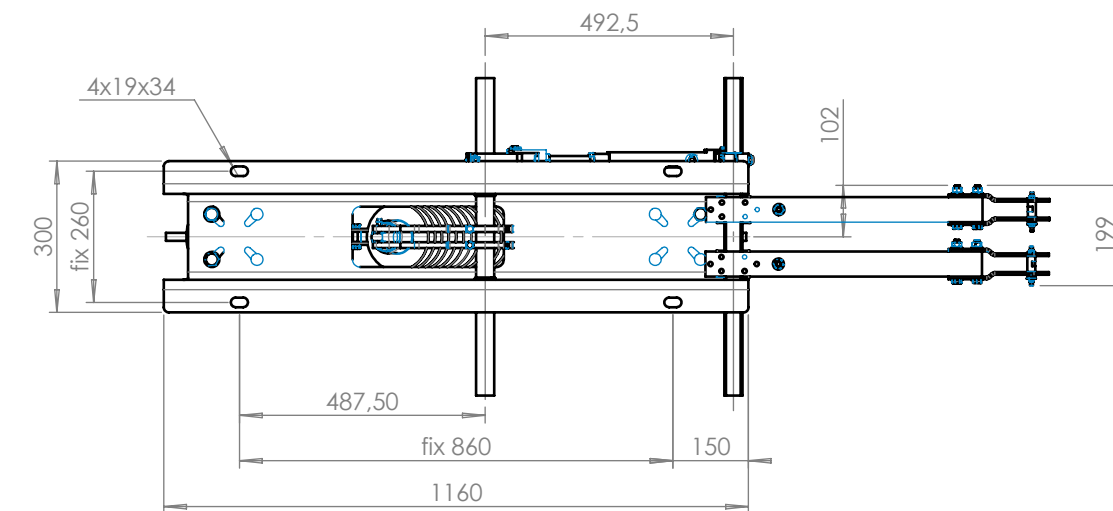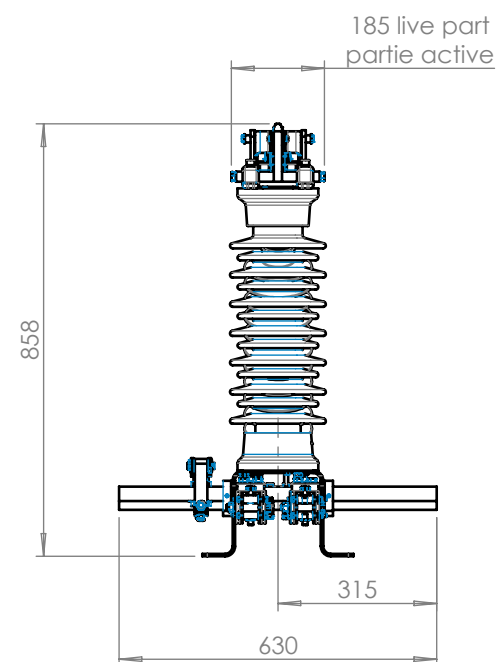


*:90° to open disconnecter and close earthing switch
*:90° pour ouvrir le sectionneur et fermer la MALT

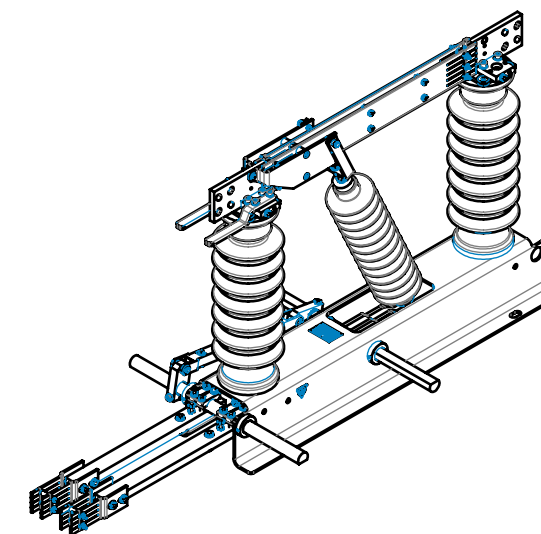

DÉTAIL B
ECHELLE 1 : 5

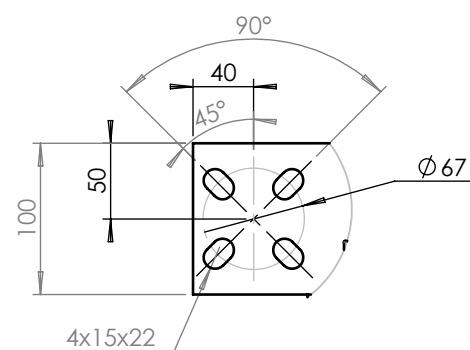

PLAGE DE RACCORDEMENT: CUIVRE ETAME
TERMINAL PAD: TINNED COPPER

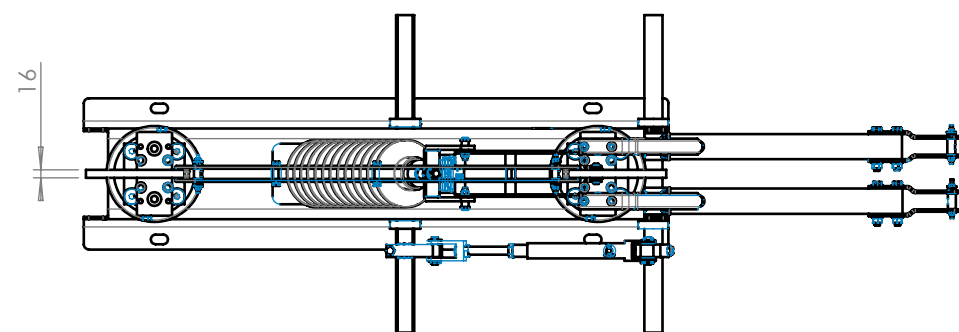


Libellés /
Titles :

SECTIONNEUR SBE 52kV-3150A AVEC MALT DISCONNECTOR SBE 52kV-3150 WITH EARTHING SWITCH

A3

Ech. / Scale:
1:15

PAGE /
SHEET
1/1




ENCOMBREMENT / DIMENSION DRAWING

REVISION	DATE	MODIFICATION	DESSINE / BY	VERIFIE / CHECKED	APPROUVE / APPROVED
00	22/05/2014	CREATION	GB	JBB	GB


CE DOCUMENT, PROPRIETE DE SDCEM
NE PEUT ETRE NI COMMUNIQUE
NI UTILISE SANS SON AUTORISATION
THIS DRAWING IS THE SOLE PROPERTY
OF SDCEM ANY REPRODUCTION OR
USE IS PROHIBITED WITHOUT WRITTEN
PERMISSION

N° 121967-FR-EN


SEULS LES DOCUMENTS REMIS EN
CONFIRMATION DE COMMANDE NOUS
ENGAGENT POUR EXECUTION CONFORME
ONLY DOCUMENTS SUBMITTED AS
ORDER MAY BE CONSIDERED AS
BINDING FOR MANUFACTURING PURPOSE

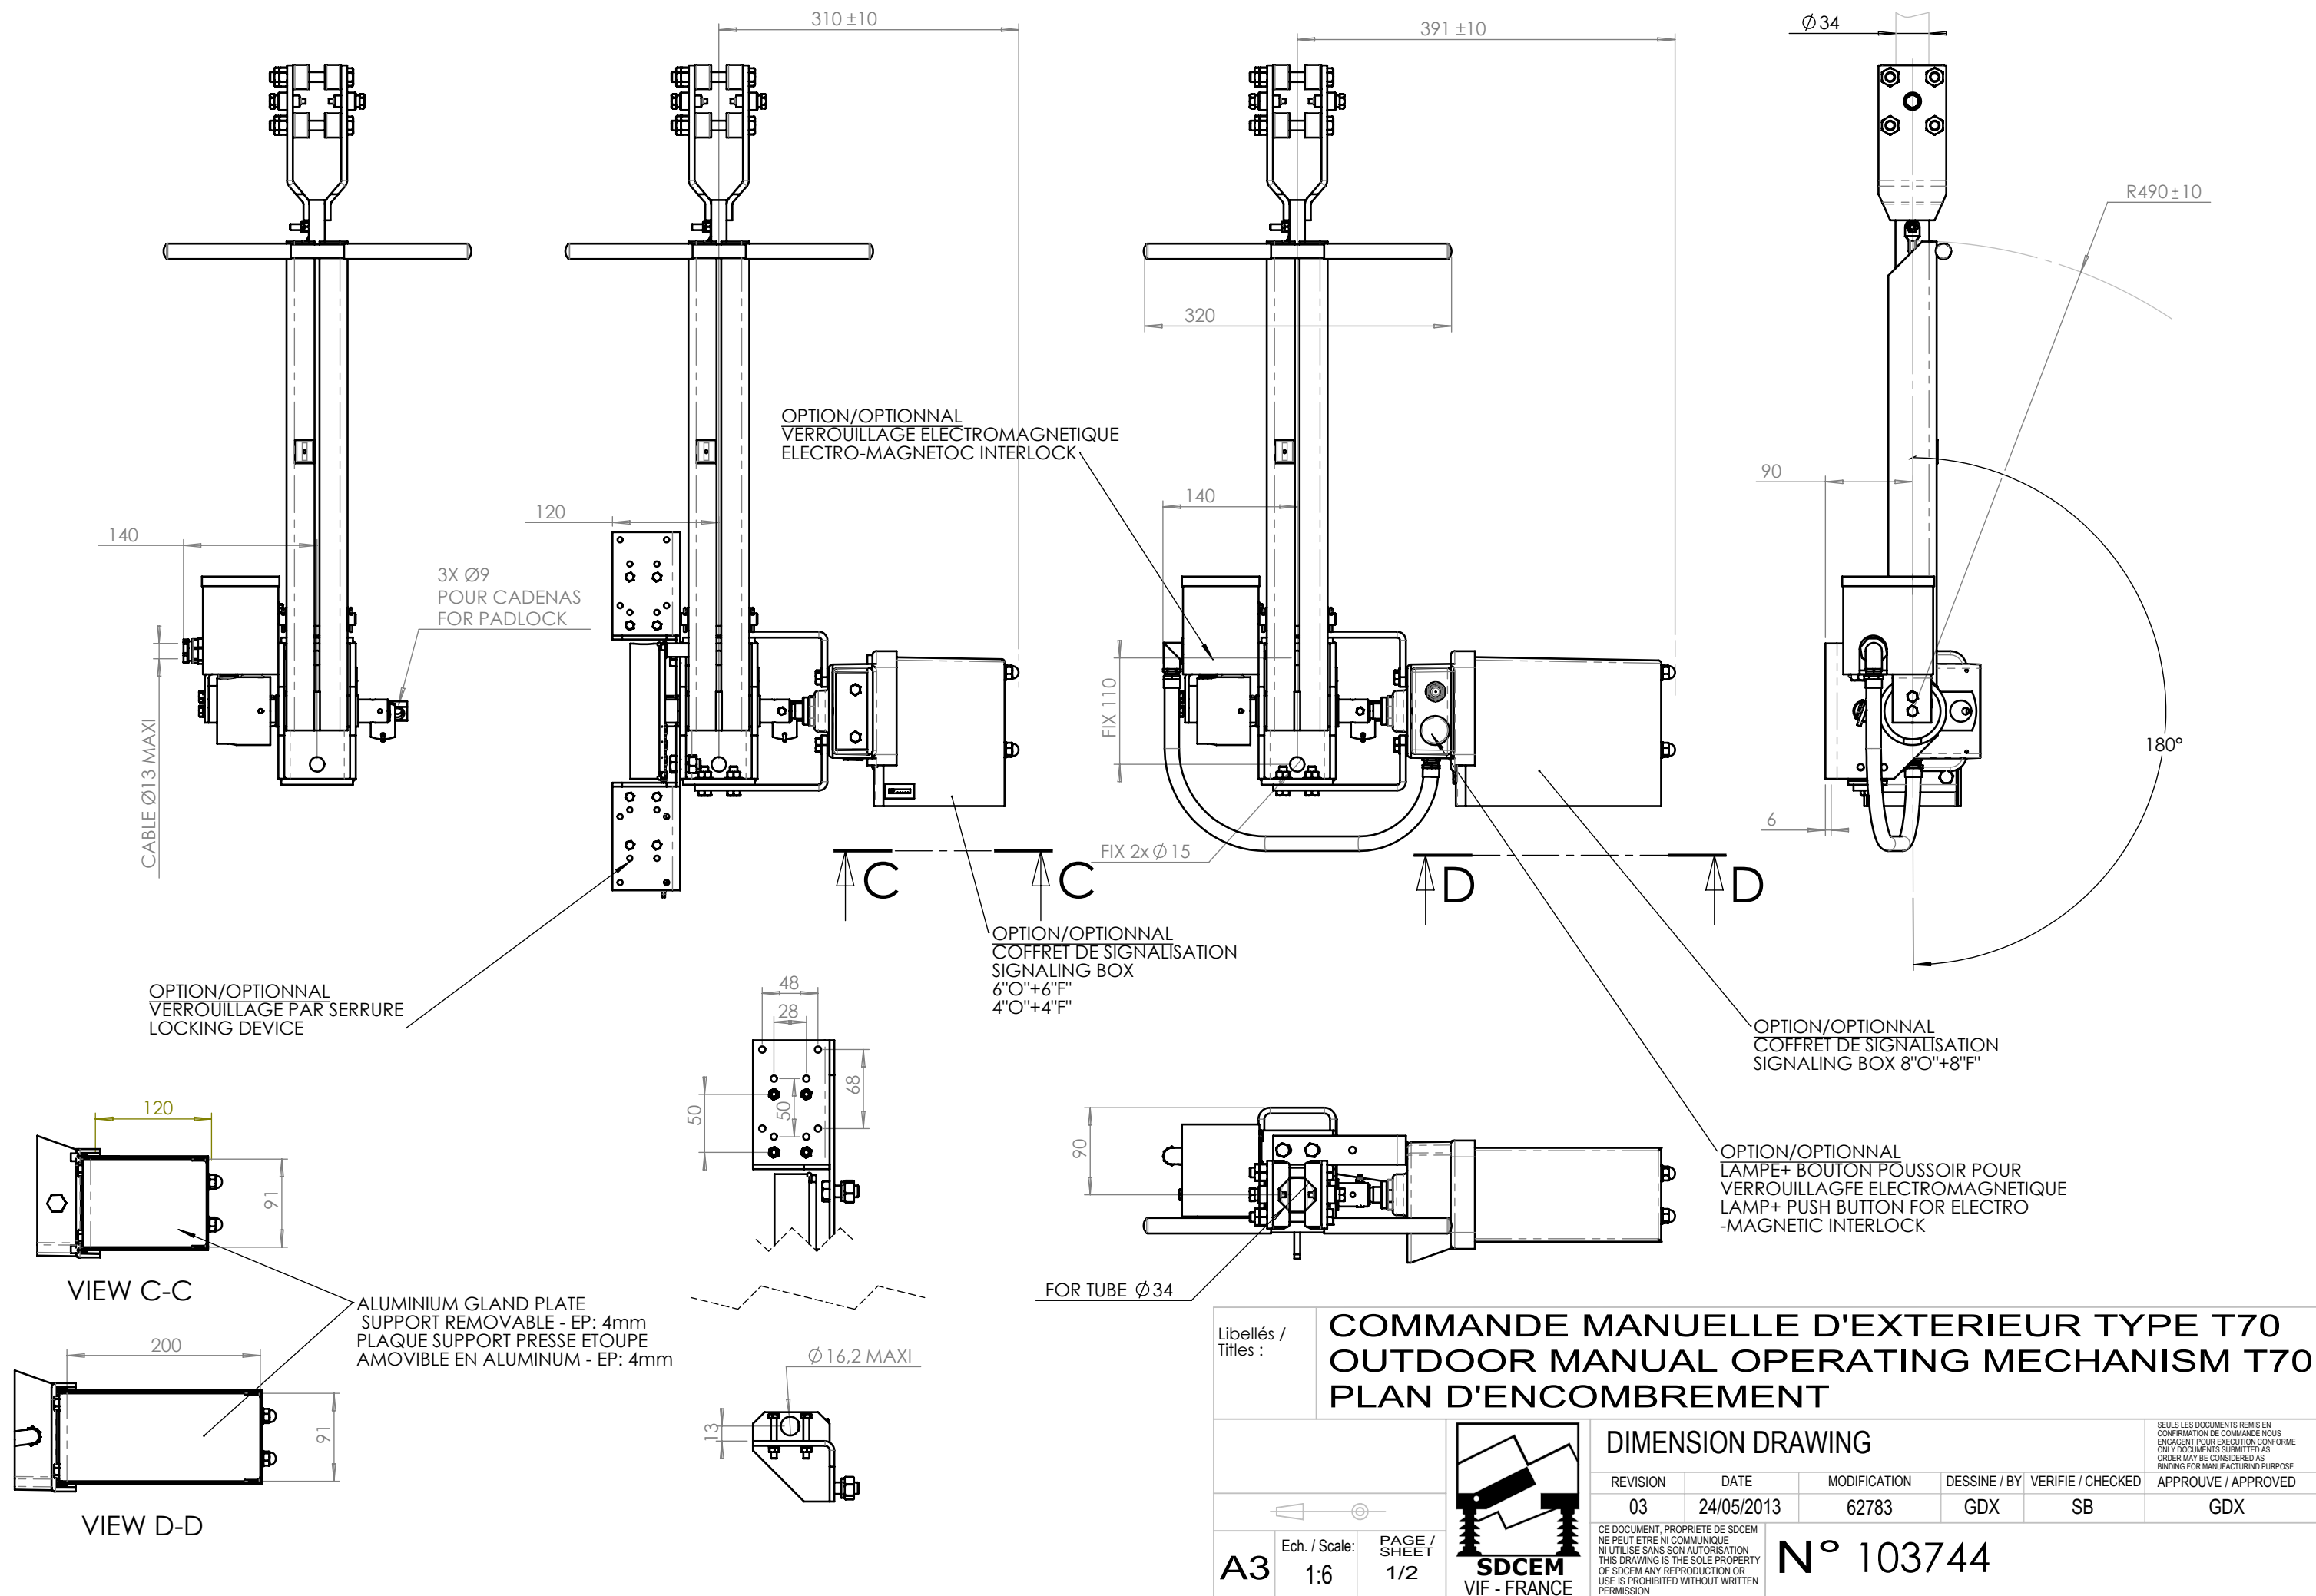


POSITION A

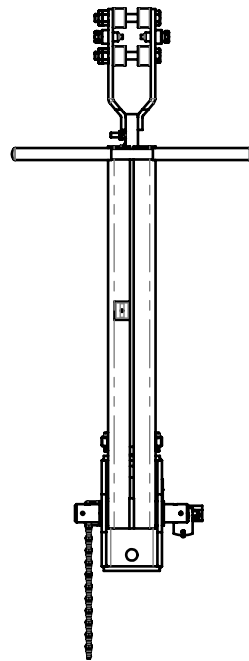


POSITION B

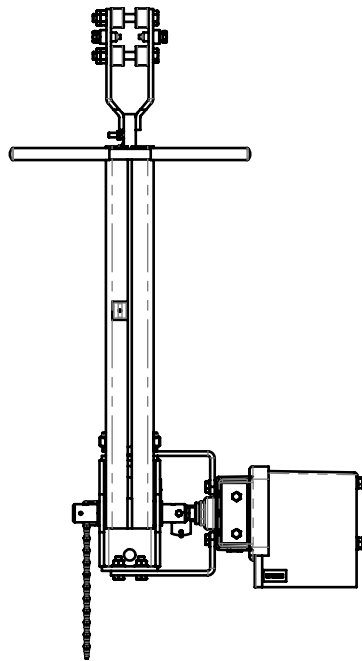


POSITION C

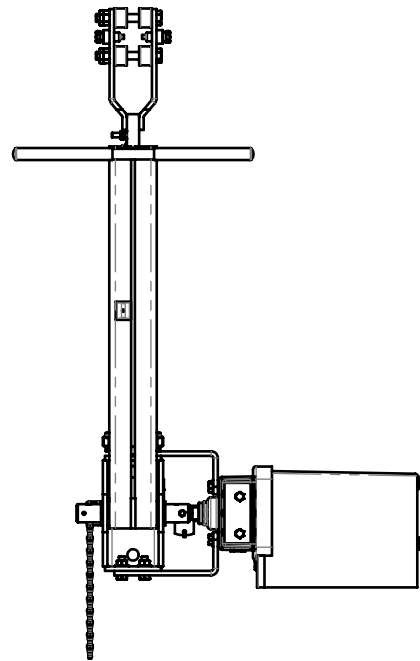


POSITION D

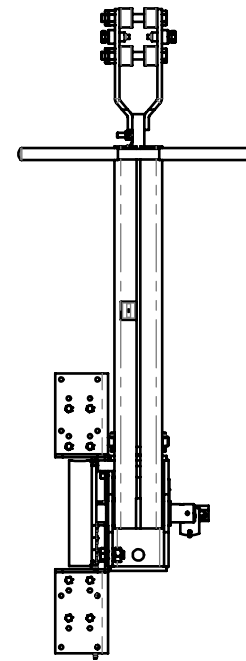


POSITION E

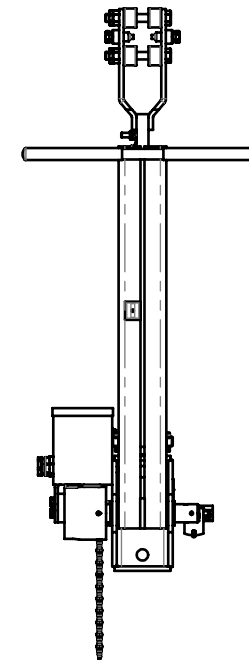


POSITION G

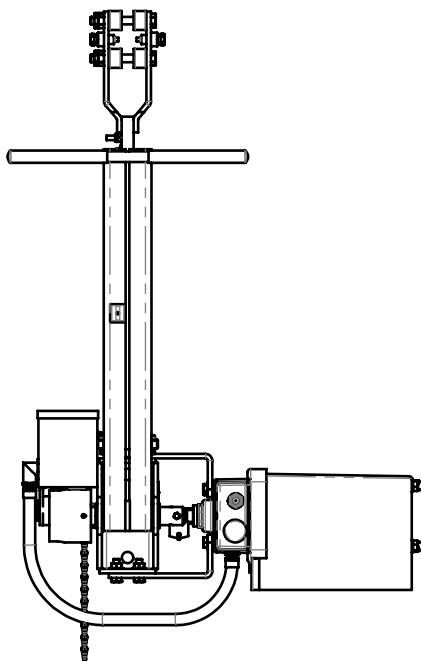


POSITION H

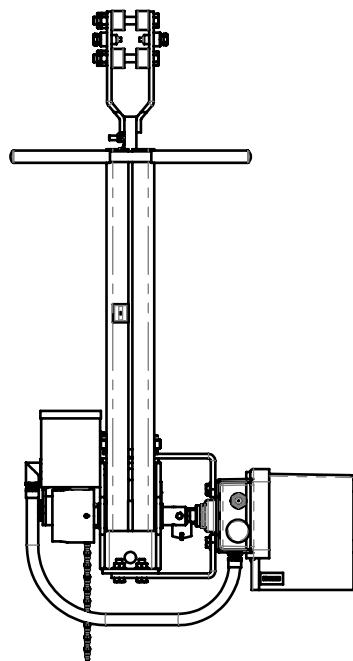

POSITION I

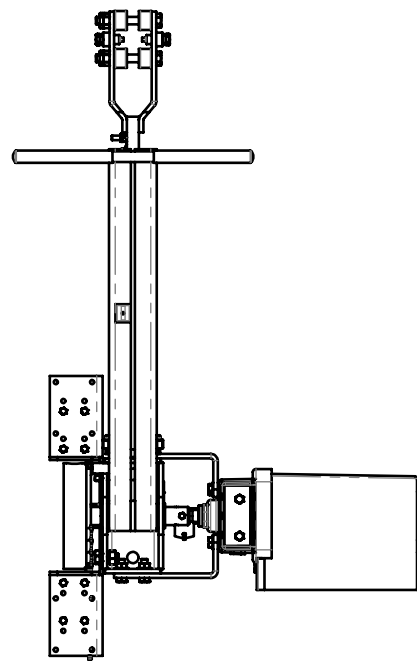

POSITION J

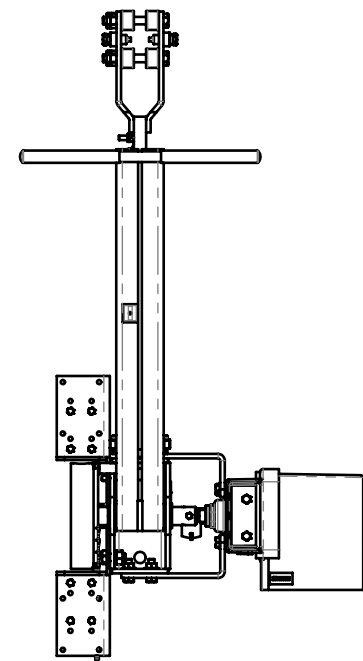
Libellés /
Titles :

COMMANDE MANUELLE D'EXTERIEUR TYPE T70
OUTDOOR MANUAL OPERATING MECHANISM T70
PLAN D'ENCOMBREMENT

A3

Ech. / Scale:
1:10

PAGE /
SHEET
2/2



DIMENSION DRAWING

REVISION

03

DATE _____

24/05/2013

MODIFICATION

62783

DESSINE / BY

GDX

Y	VERIFIE / CHECKED
---	-------------------

SB


BINDING FOR MANUFACTURING PURPOSE
APPROVE / APPROVED

GDX

CE DOCUMENT, PROPRIETE DE SDCEM
NI PEUT ETRE NI COMMUNIQUE
NI UTILISE SANS SON AUTORISATION
THIS DRAWING IS THE SOLE PROPERTY
OF SDCEM ANY REPRODUCTION OR
USE IS PROHIBITED WITHOUT WRITTEN
PERMISSION

N° 103744

SEULS LES DOCUMENTS REMIS EN
CONFIRMATION DE COMMANDE NOUS
ENGAGENT POUR EXECUTION CONFORME
ONLY DOCUMENTS SUBMITTED AS
ORDER MAY BE CONSIDERED AS
BINDING FOR MANUFACTURING PURPOSE

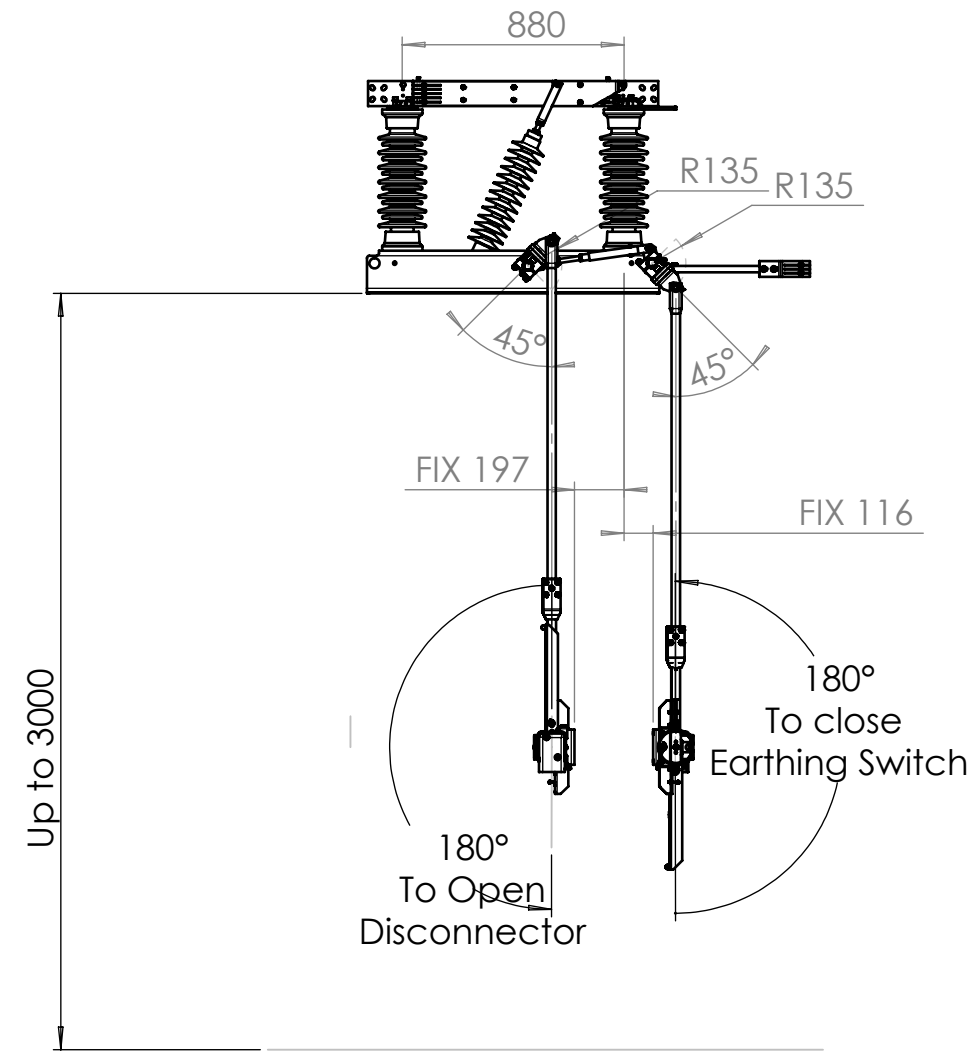

L'INSTALLATEUR DOIT S'ASSURER QUE LES DISTANCES ENTRE L'OPERATEUR ET LES PARTIES SOUS TENSION SOIENT CONFORMES AUX DIRECTIVES EN VIGUEUR ET PREVOIR LA PROTECTION APPROPRIEE.
THE CONTRACTOR MUST CHECK THAT THE DISTANCE BETWEEN THE OPERATOR AND LIVES PARTS ARE COMPLYING WITH THE LOCAL RULES AND INSTALL APROPRIATE SAFETY GUARD.

FOR THE EQUIPMENT WHICH IS NOT SHOWN ON THE DRAWING, THE CONTARCTOR MUST CHECK THE CLEARANCES BETWEEN LIVES PARTS AND EARTH, AND BETWEEN PHASES.
POUR L'EQUIPEMENT NON REPRESENTÉ SUR LE PLAN, L'INSTALLATEUR DOIT VÉRIFIER LES DISTANCES ENTRE LES PARTIES SOUS TENSION ET LA MASSE, ET ENTRE LES PHASES.

TOLERANCE DIMENSIONNELLE NON SPECIFIEE = $\pm 10\%$
 DIMENSIONAL TOLERANCE UNSPECIFIED = $\pm 10\%$

SBE 52Kv 3150A 1 EARTHING SWITCH
MANUAL OPERATING MECHANISM T70



ERECTION DRAWING

REVISION	DATE	MODIFICATION	DESSINE / BY	VERIFIE / CHECKED	APPROUVE / APPROVED
00	24/05/2018	CREATION	SFE	SB	SFE




Ech. / Scale:
1:30

PAGE
SHEET
1/2

CE DOCUMENT, PROPRIETE DE SDCEM
NE PEUT ETRE NI COMMUNIQUE
NI UTILISE SANS SON AUTORISATION
THIS DRAWING IS THE SOLE PROPERTY
OF SDCEM ANY REPRODUCTION OR
USE IS PROHIBITED WITHOUT WRITTEN
PERMISSION

N° D0022757

SEULS LES DOCUMENTS REMIS EN
CONFIRMATION DE COMMANDE NOUS
ENGAGENT POUR EXECUTION CONFORME
ONLY DOCUMENTS SUBMITTED AS
ORDER MAY BE CONSIDERED AS
BINDING FOR MANUFACTURING PURPOSE

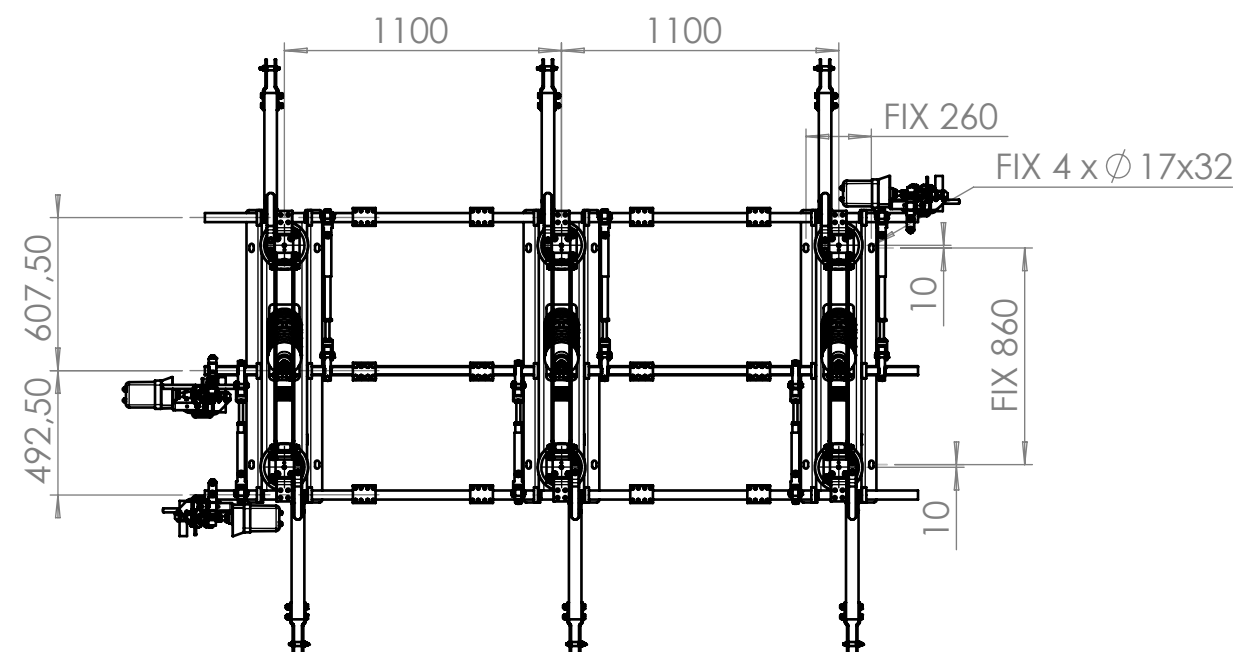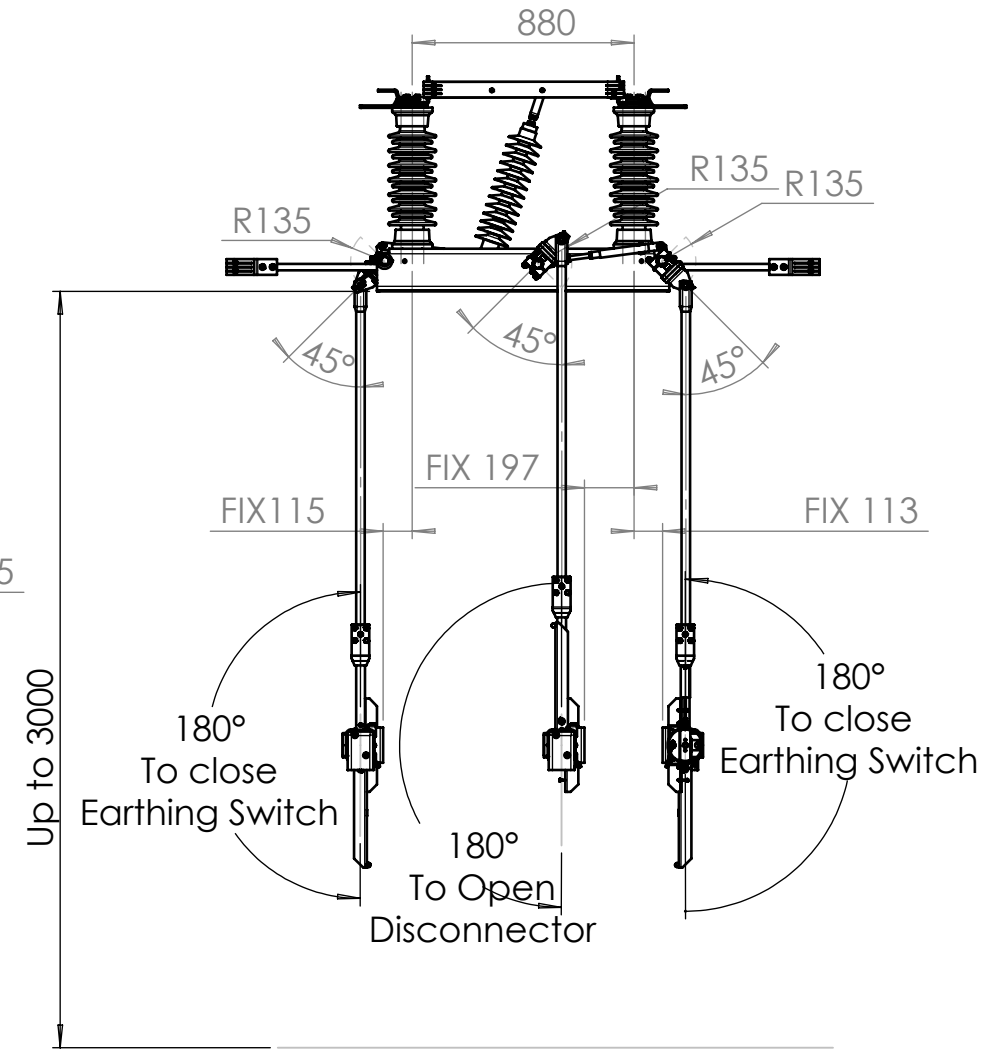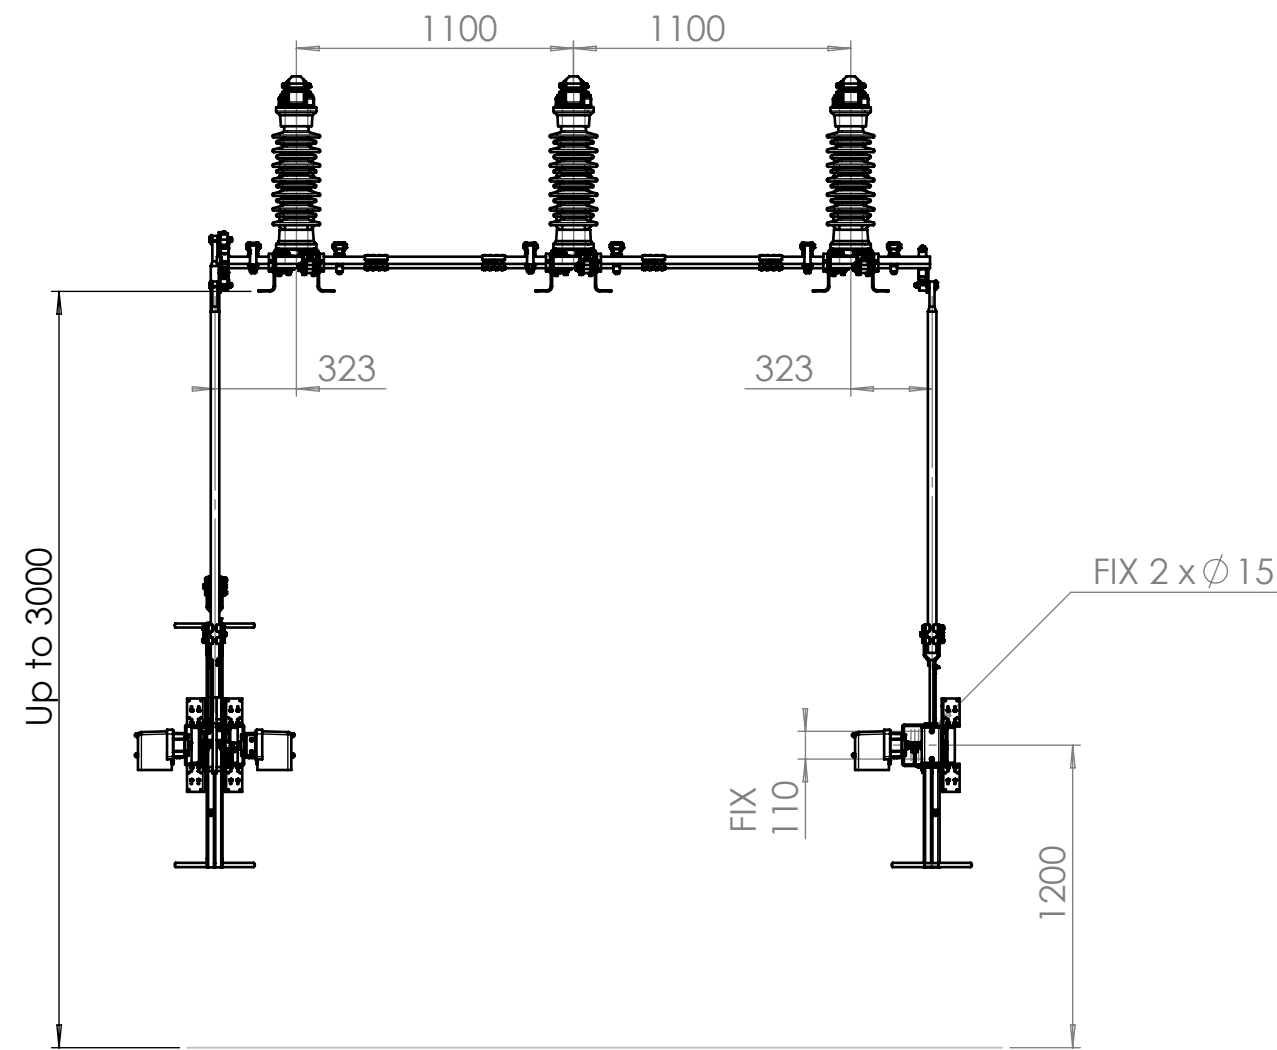

LES SUPPORTS ET CALAGES HORS NOMENCLATURE NE SONT PAS DE FOURNITURE SDCEM.
FRAMES AND BRACKETS WHICH ARE NOT IN THE SCHEDULE ARE NOT SUPPLIED BY SDCEM.

L'INSTALLATEUR DOIT S'ASSURER QUE LES DISTANCES ENTRE L'OPERATEUR ET LES PARTIES SOUS TENSION
SOIENT CONFORMES AUX DIRECTIVES EN VIGUEUR ET PREVOIR LA PROTECTION APPROPRIEE.
THE CONTRACTOR MUST CHECK THAT THE DISTANCE BETWEEN THE OPERATOR AND LIVES PARTS
ARE COMPLYING WITH THE LOCAL RULES AND INSTALL APROPRIATE SAFETY GUARD.

FOR THE EQUIPMENT WHICH IS NOT SHOWN ON THE DRAWING, THE CONTARCTOR MUST CHECK THE CLEARANCES
BETWEEN LIVES PARTS AND EARTH, AND BETWEEN PHASES.
POUR L'EQUIPEMENT NON REPRESENTE SUR LE PLAN, L'INSTALLATEUR DOIT VERIFIER LES DISTANCES
ENTRE LES PARTIES SOUS TENSION ET LA MASSE, ET ENTRE LES PHASES.

TOLERANCE DIMENSIONNELLE NON SPECIFIEE = $\pm 10\%$
DIMENSIONAL TOLERANCE UNSPECIFIED = $\pm 10\%$

Libellés /
Titles :

SBE 52kV 2000A 2 EARTHING SWITCH MANUAL OPERATING MECHANISM T70

Statut /Status:



ERECTION DRAWING

REVISION	DATE	MODIFICATION	DESSINE / BY	VERIFIE / CHECKED	APPROUVE / APPROVED
00	24/05/2018	CREATION	SFE	SB	SFE

A3

Ech. / Scale:
1:30

PAGE /
SHEET
1/2

CE DOCUMENT, PROPRIETE DE SDCEM
NE PEUT ETRE NI COMMUNIQUE
NI UTILISE SANS SON AUTORISATION
THIS DRAWING IS THE SOLE PROPERTY
OF SDCEM ANY REPRODUCTION OR
USE IS PROHIBITED WITHOUT WRITTEN
PERMISSION

N° D0022984

SEULS LES DOCUMENTS REMIS EN
CONFIRMATION DE COMMANDE NOUS
ENGAGENT POUR EXECUTION CONFORME
ONLY DOCUMENTS SUBMITTED AS
ORDER MAY BE CONSIDERED AS
BINDING FOR MANUFACTURING PURPOSE